




Excellence in Air Distribution

KLPS-D Unit Sizes 1,2, 3, and 5


Drip Tray

JOB NAME _____
 ENGINEER _____
 CONTRACTOR _____
 TAG _____

SUBMITTAL SHEET

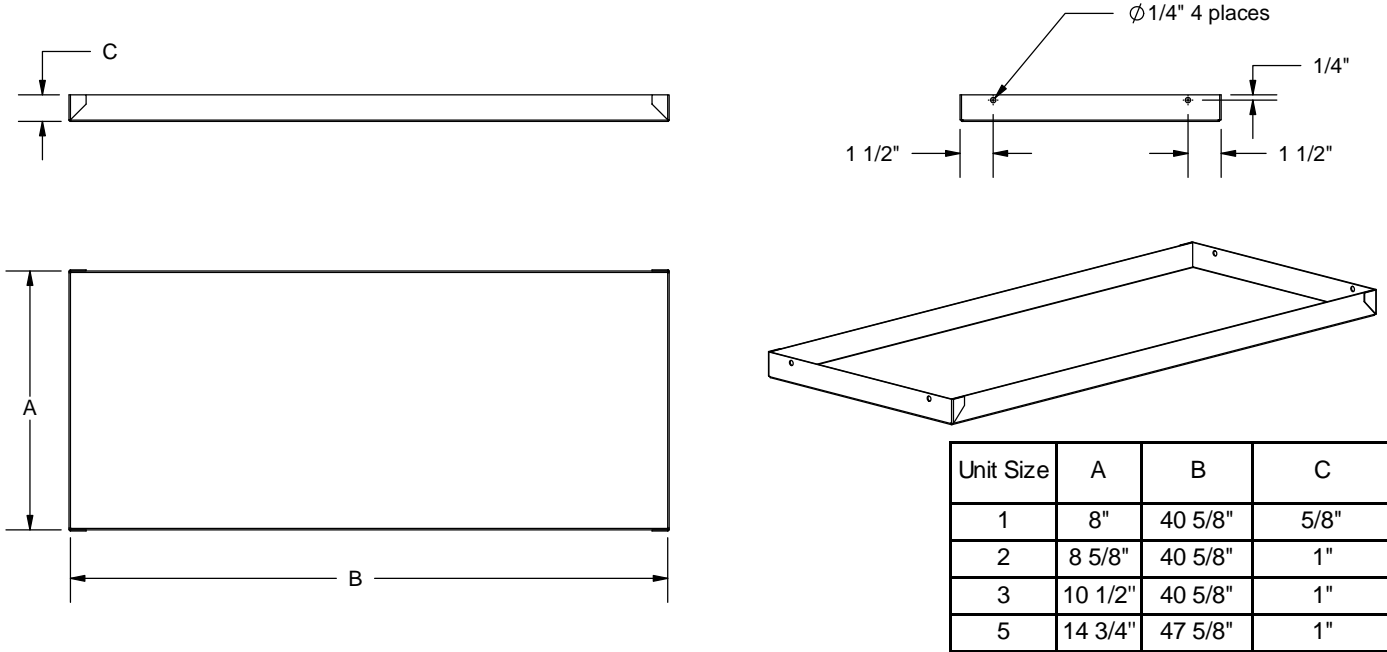

- Drip Tray Ships Loose for Field Installation
- 20 GA Galvanized Steel Construction
- Four 1/4" Holes on the Sides for Mounting
- Customer is Responsible for Condensate Management, Should it Occur
- Sealant Applied in Corners to Prevent Leakage

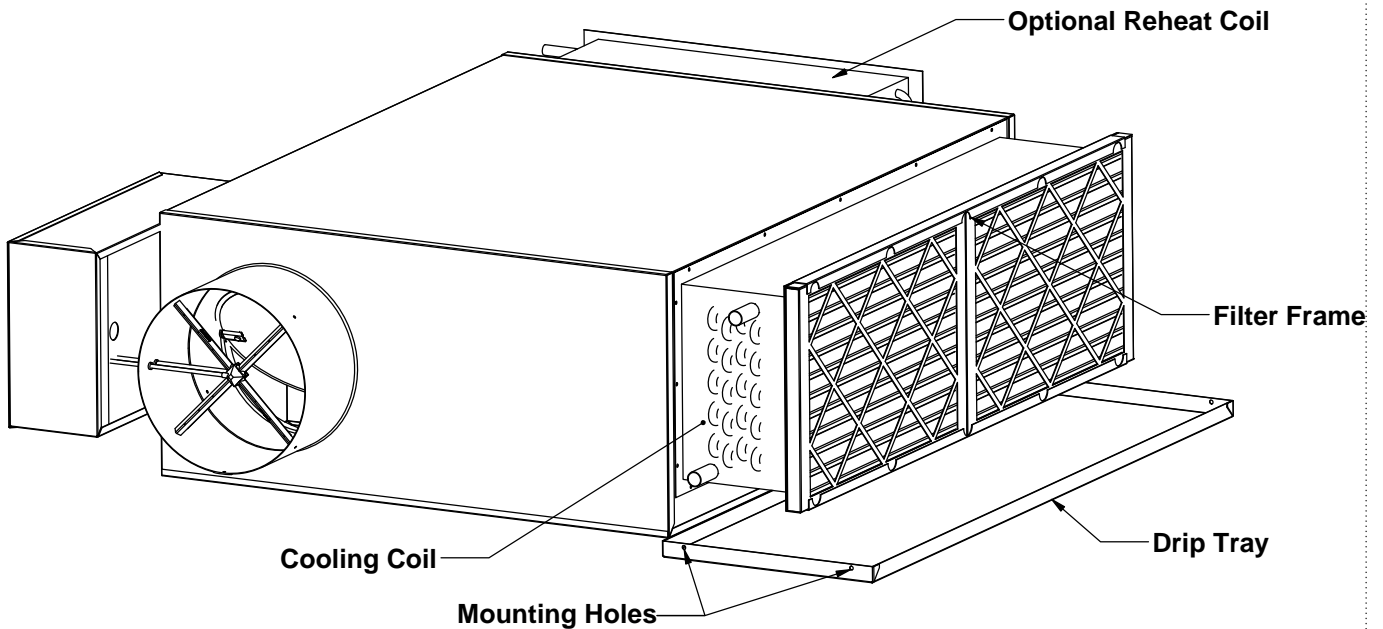

Installation Guide

1. Position Drip Tray Directly Below Cooling Coil
2. Support Tray in a Manner Appropriate to Job Site Conditions

Revision Date: 10/13

Form: TUS03-135-000CP-3

Replaces: TUS03-350-000CP-2

Product Information is Subject to Change Without Notice